

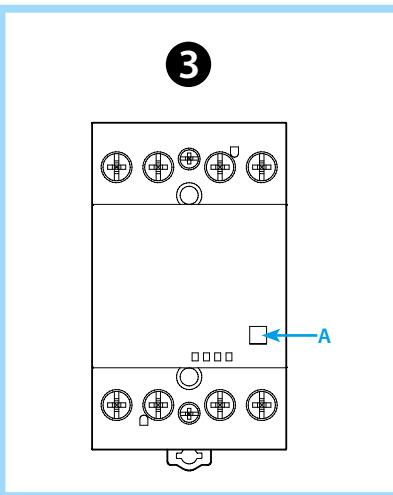
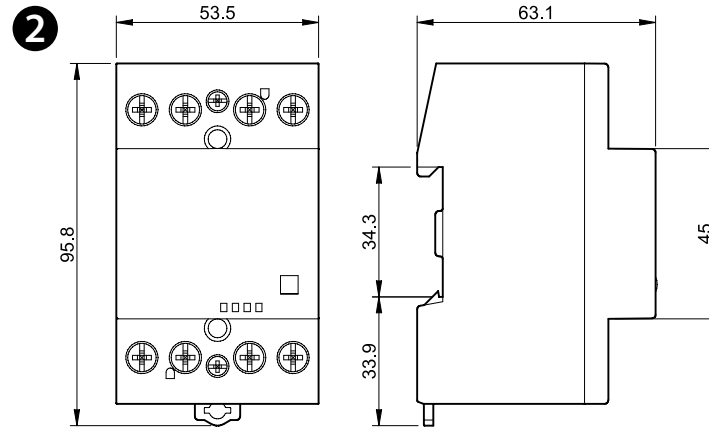


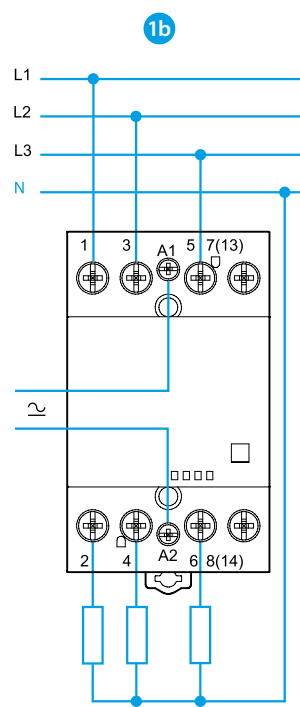

22.44

	22.44.0.xxx.4x10 U_N [12 - 24 - 110...120 (110 V DC) - 230...240 (220 V DC)] V AC (50/60 Hz) / DC $U_{min} - U_{max}$ (0.85...1.1) U_N P 5 VA (50 Hz) / 5 W	
	 A1 1 3 5 7(13) A2 2 4 6 8(14) 4 NO (4310)	 A1 1 3 5 7 A2 2 4 6 8 3 NO + 1 NC (4710)
40 A 440 V AC (EN 61095: 2009 - EN 60947-4-1: 2009)		
	AC1 / AC-7a (400 V) 16000 VA	4000 W
	AC3 / AC-7b (400 V) 22 A	1500 W
	DC1 (30/110/220)V (40/4/1.2) A	CFL-LED 1000 W
	(-5...+55)°C	
IP20		

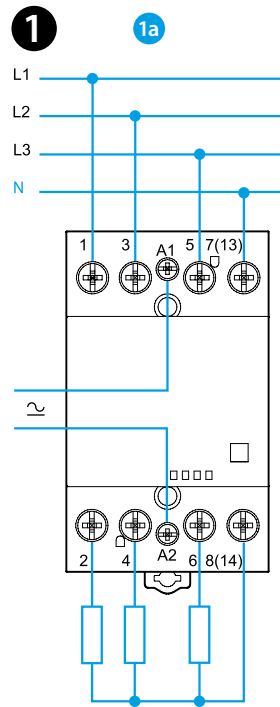

4 **22.44 + (022.63 / 022.65)**

022.63

022.65

022.63	2 NO (DPST-NO)
022.65	1 NO (SPST-NO) + 1 NC (SPST-NC)
	AC1 6 A AC15 (230 V AC) 700 VA

ENGLISH

22.44
MODULAR CONTACTORS 40 A
 Compliant with EN 61095:2009 and with EN 60947-4-1: 2009

- 1 CONNECTION DIAGRAM**
 - 1a Line and neutral switched
 - 1b Line only switched
- 2 OUTLINE DRAWINGS**
- 3 FRONT VIEW**
 - A Mechanical indicator
- 4 ACCESSORIES**
 - Auxiliary contact module available (022.63/022.65) for "Quick assembly" to the main contactor

NOTE

- The maximum ambient temperature for 3 adjacent contactors is +40°C. Where more than 3 contactors are installed, it is necessary to interpose an air gap of 9 mm between each group of three contactors
- The maximum ambient temperature for 2 adjacent contactors is +55°C. Where more than 2 contactors are installed, it is necessary to interpose an air gap of 9 mm between each group of two contactors
- Operate / release time: (20 / 45) ms