









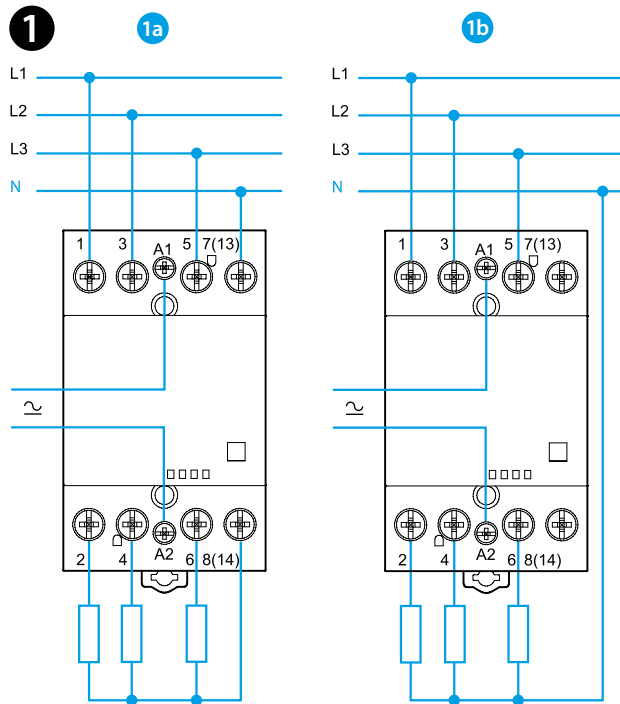





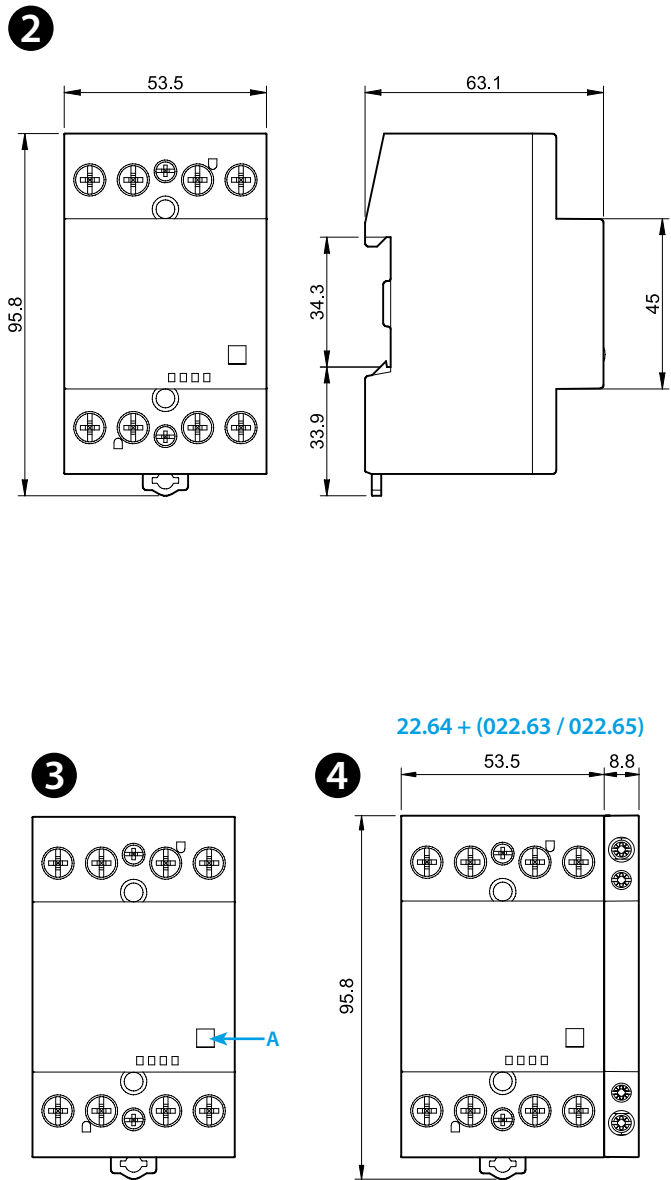


22.64

22.64.0.xxx.4x10				
	$U_N$ [12-24-110...120(110 V DC)-230...240(220 V DC)] V AC(50/60 Hz) / DC $U_{min}-U_{max}$ (0.85-1.1) $U_N$ P 5 VA (50 Hz) / 5 W			
	 A1 1 3 5 7(13) A2 2 4 6 8(14) 4 NO (4310)	 A1 1 3 5 7 A2 2 4 6 8 3 NO + 1 NC (4710)	 A1 1 3 5 7 A2 2 4 6 8 2 NO + 2 NC (4610)	
	63 A 440 V AC (EN 61095: 2009-EN 60947-4-1: 2009)			
	AC1/AC-7a (400 V) 24000 VA	 5000 W		
	AC3/AC-7b (400 V) 30 A	 2000 W		
DC1 (30/110/220)V (63/4/1.2)A	CFL-LED 1500 W			
 (400-440 V AC) 15 kW				
	(-5...+55)°C			
IP20				



	<b>022.63</b> 2 NO (DPST-NO)	
	<b>022.65</b> 1 NO (SPST-NO) + 1 NC (SPST-NC)	
	AC1	6 A
	AC15 (230 V AC)	700 VA



## ENGLISH

### 22.64

#### MODULAR CONTACTORS 63 A

Compliant with EN 61095: 2009 and with EN 60947-4-1: 2009

#### 1 CONNECTION DIAGRAM

**1a** Line and neutral switched

**1b** Line only switched

#### 2 OUTLINE DRAWINGS

#### 3 FRONT VIEW

**A** Mechanical indicator

#### 4 ACCESSORIES

Auxiliary contact module available (022.63/022.65) for "Quick assembly" to the main contactor

#### NOTE

- The maximum ambient temperature for 3 adjacent contactors is +40°C. Where more than 3 contactors are installed, it is necessary to interpose an air gap of 9 mm between each group of three contactors
- The maximum ambient temperature for 2 adjacent contactors is +55°C. Where more than 2 contactors are installed, it is necessary to interpose an air gap of 9 mm between each group of two contactors
- Operate/release time: (20/45)ms